



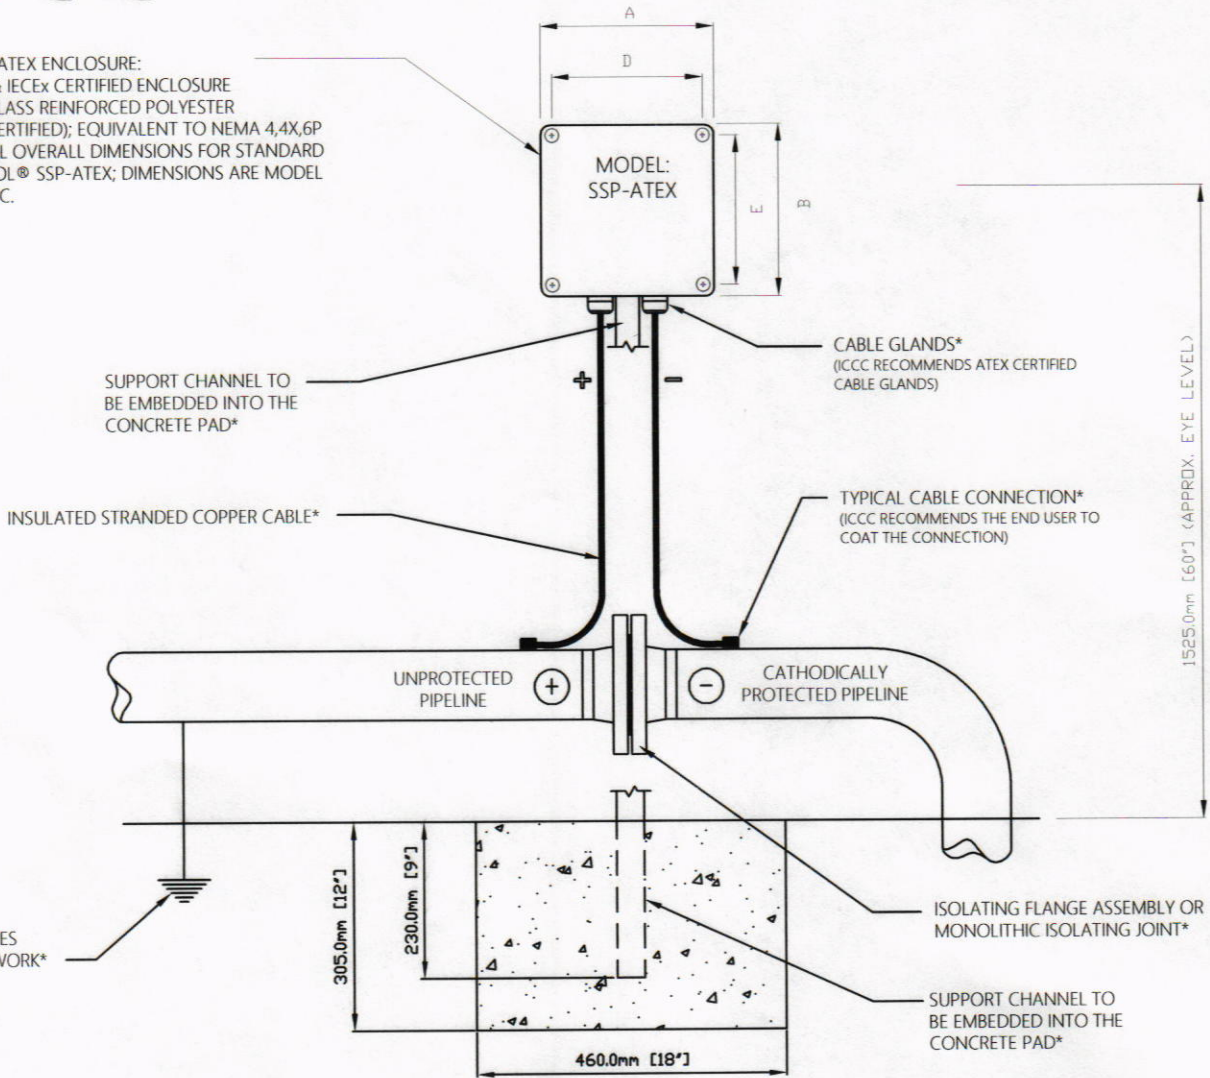

TYPICAL SSP-ATEX ENCLOSURE:

- ATEX & IECEx CERTIFIED ENCLOSURE
- FIBREGLASS REINFORCED POLYESTER
- IP67 (CERTIFIED); EQUIVALENT TO NEMA 4,4X,6P
- TYPICAL OVERALL DIMENSIONS FOR STANDARD RUSTROL® SSP-ATEX; DIMENSIONS ARE MODEL SPECIFIC.

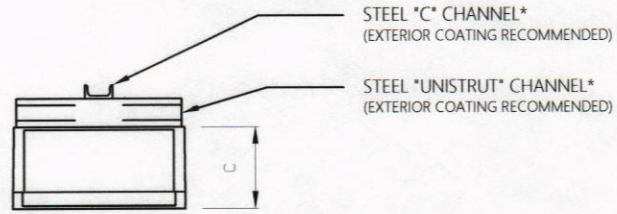

NOTES:

- 1) NOT DRAWN TO SCALE.
- 2) NOMINAL DIMENSIONS, ALL DIMENSIONS ARE APPROXIMATE.
- 3) ALL DIMENSIONS ARE SHOWN WITH BOTH METRIC & IMPERIAL UNITS AND ARE GOVERNED BY THE IMPERIAL MEASUREMENTS AS SHOWN.
- 4) TYPICAL INSTALLATION ONLY. VARIATIONS ARE COMMON BASED ON THE SITE REQUIREMENTS. ALL NOTED (\*) DETAILS ARE PROVIDED AS SUGGESTIONS ONLY, AND ARE TO BE PROVIDED BY OTHERS. ALL NOTED (\*) DETAILS ARE NOT INCLUDED WITH RUSTROL® PRODUCTS.
- 5) CABLE LENGTH IS RECOMMENDED NOT TO EXCEED 2 METRES (6 FT) IN EITHER DIRECTION TO AND FROM THE CATHODIC ISOLATOR® MODEL: SSP-ATEX. ICCC RECOMMENDS TWO (2) CABLES PER TERMINAL.
- 6) INSTALLATION IS RECOMMENDED TO BE UNDERTAKEN BY AN AUTHORIZED ELECTRICIAN/CONTRACTOR FAMILIAR WITH INSTALLATION CODES WITHIN THE JURISDICTION OF THE COUNTRY FOR WHICH THE RUSTROL® PRODUCT IS BEING INSTALLED WITHIN.
- 7) ICCC IS NOT LIABLE FOR DAMAGES CAUSED BY INCOMPATIBILITY OF ANY NON-RUSTROL® COMPONENT CONNECTED TO THE RUSTROL® SYSTEM.
- 8) WHILE PUBLISHED STATEMENTS ARE BELIEVED TO BE ACCURATE, THEY ARE OFFERED AS SUGGESTIONS ONLY. ANY USE THEREOF IS AT THE USER'S INDEPENDENT DISCRETION.
- 9) THIS DRAWING REMAINS THE PROPERTY OF INTERPROVINCIAL CORROSION CONTROL COMPANY LTD.

No.	Date	By	Revision	Chk'd By	Date
0	APR 20/2007	MA	ISSUED FOR REVIEW		APR 20/2007
1	FEB 10/2012	HO	ADDED ATEX LOGO		
2	SEPT 4/2015	HO	ADDED IECEx LOGO & ADDITIONAL NOTES		
3	MAR 10/2020	BC	UPDATED NOTES		

**INTERPROVINCIAL  
CORROSION CONTROL  
COMPANY LIMITED**

930 Sheldon Court  
Burlington Ontario Canada  
Ph: (905) 634-7751 Fax: (905) 333-4313

www.Rustrol.com  
Copyright 2020

Project <b>TYPICAL INSTALLATION OF RUSTROL® CATHODIC ISOLATOR® MODEL: SSP-ATEX</b>	
Drawing No. <b>SSP-04</b>	Rev. <b>3</b>